


Date : 11/14/2023
Project No : 2022C218
Client Company : CW Matthews
Arrival Time : 11/14/2023 8:00
Onsite Hours : 9:30

ASEC Report ID : 63044
Name of the Project : Ramp 20 Pavement Replacement -
IFB-1230102
Project Location : HJAIA
Weather : sunny
Departure Time : 11/14/2023 17:30
ASEC Technician Name : Aminullah Azimi

At the request of the client's representative, our AS ENGINEERING AND CONSULTING, LLC (ASEC) representative, Amin Azimi visited the job site to observe the contractor's work activities from a quality standpoint to verify compliance with project drawings/specifications, applicable codes, and materials submittals and conducted QC testing per the project drawings and specifications. The following observations were made on site this shift:

- performed straight edge for Ramp 20 Phase 4, from lanes 1 to 17 and phase 5 from lanes 1 to 7, and coring for phase 4 and 5.
- Making samples of beams for ramp 20 phase 4 and phase 5. spalls.
- Placement of backfill GAB for end around between STA 7019 to STA 7021+50 in the time arrival already compacted. Density testing was performed using a Troxler nuclear gauge (#3430, serial #85759). Test results indicated that the compacted material met project requirement of 95% of the maximum dry density.

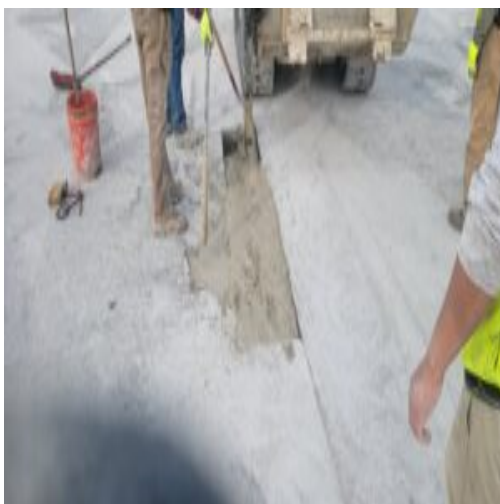

Date : 11/14/2023
Project No : 2022C218
Client Company : CW Matthews
Arrival Time : 11/14/2023 8:00
Onsite Hours : 9:30

ASEC Report ID : 63044
Name of the Project : Ramp 20 Pavement Replacement -
IFB-1230102
Project Location : HJAIA
Weather : sunny
Departure Time : 11/14/2023 17:30
ASEC Technician Name : Aminullah Azimi

The results presented in this report relate only to the items tested. This report shall not be reproduced, except in full, without written approval from AS Engineering and Consulting LLC.