

Date : 04/03/2025
Project No : 2024C189
Client Company : WSP
Arrival Time : 04/09/2025 23:00
Onsite Hours : 06:45


ASEC Report ID : 79626
Name of the Project : Protovision PH II
Project Location : Lithia Springs
Weather :
Departure Time : 04/10/2025 5:45
ASEC Technician Name : Solomon Cherie

Our AS Engineering & Consulting (ASEC) representative arrived on site to observe field activities. The following tasks were performed:

Observed concrete placement that was done at C2- lift1. A total of 120 cubic yards of concrete was poured. The test results were found to meet job specifications for slump, air content and unit weight.

Three sets of six cylinders each were cast and placed in the curing box onsite.

We appreciate the opportunity to be of service to you on this project. If you have any questions regarding this report, please feel free to contact us. We will be more than happy to discuss it with you.

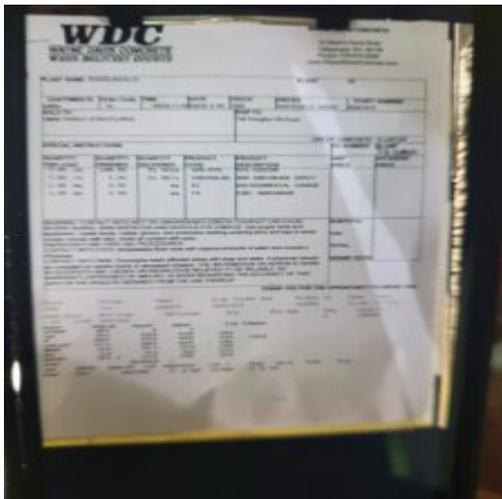

Sheet showing mix design



Spread test on a spread board

Kenneth Mosman

Kenneth Mosman

The results presented in this report relate only to the items tested. This report shall not be reproduced, except in full, without written approval from AS Engineering and Consulting LLC.