

Date : 06/05/2025
Project No : 2024C213
Client Company : WDG
Arrival Time : 06/05/2025 09:00
Onsite Hours : 02:00


ASEC Report ID : 82005
Name of the Project : Covington Town Center PH II
Project Location : Covington, GA
Weather : overcast
Departure Time : 06/05/2025 11:00
ASEC Technician Name : Sean Willett

As requested, the site was visited by our AS Engineering and Consulting (ASEC) representative for the purpose of providing quality control inspection and testing services. Visual observation techniques were employed to verify compliance with project drawing/specifications, applicable codes, and materials submittals. The following observations were observed on site this day.

On the above date, the technician was on site as requested by the contractor (Fulcrum) for the observation/testing of fill/backfill.

The technician density tested the top 2 feet of the retaining walls. Retaining wall along the backside of property by the main road and the retaining wall along building (right side) both failed compaction due to high moisture content. Compaction requirements were not met. The technician provided all tests results to the contractor and recommended to allow aerating/drying out of surficial wet soils prior to recompaction.

We appreciate the opportunity to be of service to you on this project. If you have any questions regarding this report, please feel free to contact us. We will be more than happy to discuss it with you.

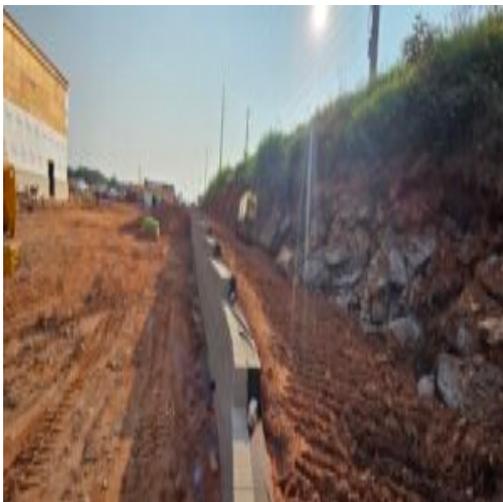

back side of site along main road retaining wall



right side of building retaining wall

Kenneth Mosman

Kenneth Mosman

The results presented in this report relate only to the items tested. This report shall not be reproduced, except in full, without written approval from AS Engineering and Consulting LLC.