

Date : 03/19/2026  
Project No : 2025C149  
Client Company : Davidson Homes  
Arrival Time :  
Onsite Hours : N/A

ASEC Report ID : 91924  
Name of the Project : Grove at E. Thompson Mill Rd  
Project Location : Buford  
Weather : N/A  
Departure Time :  
ASEC Technician Name : Samara Simha Reddy Kandi

---

**Location(S):** , , ,

**Testing:** 4 Set of concrete specimens (6 per set) were cast during the cast-in-place concrete pour at the above referenced location, in accordance with ASTM C31. The specimen will remain on site for the initial 24-48 hrs curing.

**Compliance:**  Field placement of concrete appeared to be in general accordance with the project specifications (i.e., slump, temperature, etc) (refer to remarks below)  
 Deviations and/or noncompliances were noted during the field placement (refer to remarks below)

**Specimen Pick Up:** 4 Sets of concrete specimens/ 6 specimen per set were picked up & transported to AS Engineering and Consulting LLC (ASEC) for curing and testing in accordance with ASTM C39, C670/1231

**Field Curing:** Specimen were stored for the initial 24 hours  
 Near the poured structure  
 In an insulated curing box  
 Other

**Remarks:**

The results presented in this report relate only to the items tested. This report shall not be reproduced, except in full, without written approval from AS Engineering and Consulting LLC.

Date : 03/19/2026  
 Project No : 2025C149  
 Client Company : Davidson Homes  
 Arrival Time :  
 Onsite Hours : N/A

ASEC Report ID : 91924  
 Name of the Project : Grove at E. Thompson Mill Rd  
 Project Location : Buford  
 Weather : N/A  
 Departure Time :  
 ASEC Technician Name : Samara Simha Reddy Kandi


**PLACEMENT INFORMATION - Cylinder**

<b>Set Number:</b> A	<b>Laboratory Number:</b> 2026-061
<b>Date Sampled:</b> 03/19/2026	<b>Time Sampled:</b> N/A
<b>Sampled By:</b> Samara Simha Reddy Kandi	<b>Concrete Supplier:</b> N/A
<b>Contractor:</b> N/A	<b>Mix ID:</b> N/A
<b>Truck Number:</b> N/A	<b>Quantity of Load:</b> N/A
<b>Time Batched:</b> N/A	<b>Specified Strength:</b> N/A
<b>Location of Placement:</b> N/A	<b>Concrete Temp (°f):</b> N/A
<b>Number of Samples Cast:</b> 6	<b>Air Content (%):</b> N/A
<b>Ambient Temp (°f):</b> N/A	<b>Unit Weight (pcf):</b> N/A
<b>Slump (in.):</b> N/A	<b>Water Added (gal.):</b> N/A

Specimen Number	Scheduled Test Date	Date Tested	Age (Days)	Dia (in.)	Area (sq in.)	Max Load (lbf)	Strength (psi)	% Design Strength	Fracture Type
1	03/26/2026	03/26/2026	7	3.98	12.41	69390	5520	N/A	Type 2
2	03/26/2026	03/26/2026	7	3.98	12.44	74235	5910	N/A	Type 2
3	04/16/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
4	04/16/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
5	04/16/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
6	05/14/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

UNLESS OTHERWISE SPECIFIED, TESTS WERE PERFORMED IN ACCORDANCE WITH ASTM METHODS C31, C39, C138, C143, C173, C1064.

(1) Cone (2) Cone-split (3) Vertical (4) Shear (5) Edge Fracture (6) Pointed

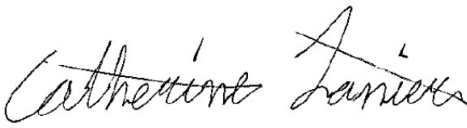

Catherine Lanier  
 Lab Manager



Kenneth Mosman

Date : 03/19/2026  
 Project No : 2025C149  
 Client Company : Davidson Homes  
 Arrival Time :  
 Onsite Hours : N/A

ASEC Report ID : 91924  
 Name of the Project : Grove at E. Thompson Mill Rd  
 Project Location : Buford  
 Weather : N/A  
 Departure Time :  
 ASEC Technician Name : Samara Simha Reddy Kandi


**PLACEMENT INFORMATION - Cylinder**

<b>Set Number:</b> B	<b>Laboratory Number:</b> 2026-061
<b>Date Sampled:</b> 03/19/2026	<b>Time Sampled:</b> N/A
<b>Sampled By:</b> Samara Simha Reddy Kandi	<b>Concrete Supplier:</b> N/A
<b>Contractor:</b> N/A	<b>Mix ID:</b> N/A
<b>Truck Number:</b> N/A	<b>Quantity of Load:</b> N/A
<b>Time Batched:</b> N/A	<b>Specified Strength:</b> N/A
<b>Location of Placement:</b> N/A	<b>Concrete Temp (°f):</b> N/A
<b>Number of Samples Cast:</b> 6	<b>Air Content (%):</b> N/A
<b>Ambient Temp (°f):</b> N/A	<b>Unit Weight (pcf):</b> N/A
<b>Slump (in.):</b> N/A	<b>Water Added (gal.):</b> N/A

Specimen Number	Scheduled Test Date	Date Tested	Age (Days)	Dia (in.)	Area (sq in.)	Max Load (lbf)	Strength (psi)	% Design Strength	Fracture Type
1	03/26/2026	03/26/2026	7	3.97	12.38	64716	5230	N/A	Type 5
2	03/26/2026	03/26/2026	7	3.96	12.35	67474	5460	N/A	Type 1
3	04/16/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
4	04/16/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
5	04/16/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
6	05/14/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

UNLESS OTHERWISE SPECIFIED, TESTS WERE PERFORMED IN ACCORDANCE WITH ASTM METHODS C31, C39, C138, C143, C173, C1064.

(1) Cone (2) Cone-split (3) Vertical (4) Shear (5) Edge Fracture (6) Pointed

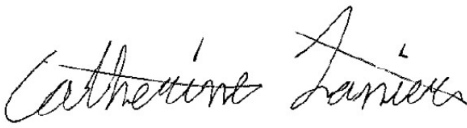

Catherine Lanier  
 Lab Manager



Kenneth Mosman

Date : 03/19/2026  
 Project No : 2025C149  
 Client Company : Davidson Homes  
 Arrival Time :  
 Onsite Hours : N/A

ASEC Report ID : 91924  
 Name of the Project : Grove at E. Thompson Mill Rd  
 Project Location : Buford  
 Weather : N/A  
 Departure Time :  
 ASEC Technician Name : Samara Simha Reddy Kandi


**PLACEMENT INFORMATION - Cylinder**

<b>Set Number:</b> C	<b>Laboratory Number:</b> 2026-061
<b>Date Sampled:</b> 03/19/2026	<b>Time Sampled:</b> N/A
<b>Sampled By:</b> Samara Simha Reddy Kandi	<b>Concrete Supplier:</b> N/A
<b>Contractor:</b> N/A	<b>Mix ID:</b> N/A
<b>Truck Number:</b> N/A	<b>Quantity of Load:</b> N/A
<b>Time Batched:</b> N/A	<b>Specified Strength:</b> N/A
<b>Location of Placement:</b> N/A	<b>Concrete Temp (°f):</b> N/A
<b>Number of Samples Cast:</b> 6	<b>Air Content (%):</b> N/A
<b>Ambient Temp (°f):</b> N/A	<b>Unit Weight (pcf):</b> N/A
<b>Slump (in.):</b> N/A	<b>Water Added (gal.):</b> N/A

Specimen Number	Scheduled Test Date	Date Tested	Age (Days)	Dia (in.)	Area (sq in.)	Max Load (lbf)	Strength (psi)	% Design Strength	Fracture Type
1	03/26/2026	03/26/2026	7	3.97	12.38	72829	5880	N/A	Type 2
2	03/26/2026	03/26/2026	7	3.96	12.35	71260	5770	N/A	Type 3
3	04/16/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
4	04/16/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
5	04/16/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
6	05/14/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

UNLESS OTHERWISE SPECIFIED, TESTS WERE PERFORMED IN ACCORDANCE WITH ASTM METHODS C31, C39, C138, C143, C173, C1064.

(1) Cone (2) Cone-split (3) Vertical (4) Shear (5) Edge Fracture (6) Pointed

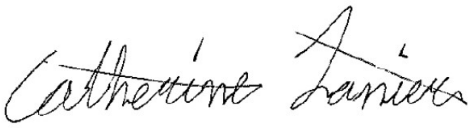

Catherine Lanier  
 Lab Manager



Kenneth Mosman

Date : 03/19/2026  
 Project No : 2025C149  
 Client Company : Davidson Homes  
 Arrival Time :  
 Onsite Hours : N/A

ASEC Report ID : 91924  
 Name of the Project : Grove at E. Thompson Mill Rd  
 Project Location : Buford  
 Weather : N/A  
 Departure Time :  
 ASEC Technician Name : Samara Simha Reddy Kandi


**PLACEMENT INFORMATION - Cylinder**

<b>Set Number:</b> D	<b>Laboratory Number:</b> 2026-061
<b>Date Sampled:</b> 03/19/2026	<b>Time Sampled:</b> N/A
<b>Sampled By:</b> Samara Simha Reddy Kandi	<b>Concrete Supplier:</b> N/A
<b>Contractor:</b> N/A	<b>Mix ID:</b> N/A
<b>Truck Number:</b> N/A	<b>Quantity of Load:</b> N/A
<b>Time Batched:</b> N/A	<b>Specified Strength:</b> N/A
<b>Location of Placement:</b> N/A	<b>Concrete Temp (°f):</b> N/A
<b>Number of Samples Cast:</b> 6	<b>Air Content (%):</b> N/A
<b>Ambient Temp (°f):</b> N/A	<b>Unit Weight (pcf):</b> N/A
<b>Slump (in.):</b> N/A	<b>Water Added (gal.):</b> N/A

Specimen Number	Scheduled Test Date	Date Tested	Age (Days)	Dia (in.)	Area (sq in.)	Max Load (lbf)	Strength (psi)	% Design Strength	Fracture Type
1	03/26/2026	03/26/2026	7	3.97	12.38	77144	6230	N/A	Type 2
2	03/26/2026	03/26/2026	7	3.96	12.35	73070	5920	N/A	Type 2
3	04/16/2026	N/A	0	N/A	N/A	N/A	N/A	N/A	N/A
4	04/16/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
5	04/16/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
6	05/14/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

UNLESS OTHERWISE SPECIFIED, TESTS WERE PERFORMED IN ACCORDANCE WITH ASTM METHODS C31, C39, C138, C143, C173, C1064.

(1) Cone (2) Cone-split (3) Vertical (4) Shear (5) Edge Fracture (6) Pointed

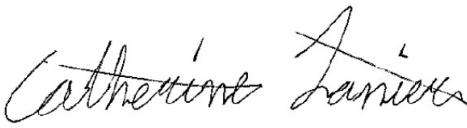

Catherine Lanier  
 Lab Manager



Kenneth Mosman