

Date : 03/27/2026
Project No : 2025C214
Client Company : Artisan
Arrival Time : 03/27/2026 11:00
Onsite Hours : 08:00

ASEC Report ID : 91929
Name of the Project : NW Unit 4 BRIDGE (Materials Testing)
Project Location : Dallas
Weather : sunny
Departure Time : 03/27/2026 19:00
ASEC Technician Name : Balu Mylabathula

Location(S): MUD MAT 3, 5, 8

Testing: 3 Set of concrete specimens (5 per set) were cast during the cast-in-place concrete pour at the above referenced location, in accordance with ASTM C31. The specimen will remain on site for the initial 24-48 hrs curing.

Compliance: Field placement of concrete appeared to be in general accordance with the project specifications (i.e., slump, temperature, etc) (refer to remarks below)
 Deviations and/or noncompliances were noted during the field placement (refer to remarks below)

Specimen Pick Up: 3 Sets of concrete specimens/ 5 specimen per set were picked up & transported to AS Engineering and Consulting LLC (ASEC) for curing and testing in accordance with ASTM C39, C670/1231

Field Curing: Specimen were stored for the initial 24 hours
 Near the poured structure
 In an insulated curing box
 Other

Remarks:

The results presented in this report relate only to the items tested. This report shall not be reproduced, except in full, without written approval from AS Engineering and Consulting LLC.

Date : 03/27/2026
 Project No : 2025C214
 Client Company : Artisan
 Arrival Time : 03/27/2026 11:00
 Onsite Hours : 08:00

ASEC Report ID : 91929
 Name of the Project : NW Unit 4 BRIDGE (Materials Testing)
 Project Location : Dallas
 Weather : sunny
 Departure Time : 03/27/2026 19:00
 ASEC Technician Name : Balu Mylabathula


PLACEMENT INFORMATION - Cylinder

Set Number: A	Laboratory Number: 2026-075
Date Sampled: 03/27/2026	Time Sampled: 12:49
Sampled By: Balu Mylabathula	Concrete Supplier: ERNST
Contractor: N/A	Mix ID: NON AEA
Truck Number: 1	Quantity of Load: 9
Time Batched: 12:01	Specified Strength: 3000
Location of Placement: MUD MAT 3	Concrete Temp (°f): 75
Number of Samples Cast: 5	Air Content (%): 2.2
Ambient Temp (°f): N/A	Unit Weight (pcf): 150.2
Slump (in.): 3.25	Water Added (gal.): N/A

Specimen Number	Scheduled Test Date	Date Tested	Age (Days)	Dia (in.)	Area (sq in.)	Max Load (lbf)	Strength (psi)	% Design Strength	Fracture Type
1	04/03/2026	04/03/2026	7	3.98	12.41	46015	3710	123.7	Type 2
2	04/24/2026	04/24/2026	28	3.97	12.38	45034	3640	121.3	Type 2
3	04/24/2026	04/24/2026	28	3.97	12.38	47365	3830	127.7	Type 2
4	04/24/2026	04/24/2026	28	3.97	12.38	46330	3740	124.7	Type 2
5	05/22/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

UNLESS OTHERWISE SPECIFIED, TESTS WERE PERFORMED IN ACCORDANCE WITH ASTM METHODS C31, C39, C138, C143, C173, C1064.

(1) Cone (2) Cone-split (3) Vertical (4) Shear (5) Edge Fracture (6) Pointed

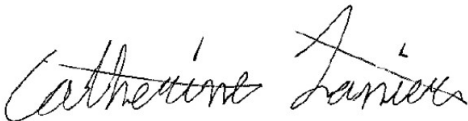

Catherine Lanier
 Lab Manager



Kenneth Mosman

Date : 03/27/2026
 Project No : 2025C214
 Client Company : Artisan
 Arrival Time : 03/27/2026 11:00
 Onsite Hours : 08:00

ASEC Report ID : 91929
 Name of the Project : NW Unit 4 BRIDGE (Materials Testing)
 Project Location : Dallas
 Weather : sunny
 Departure Time : 03/27/2026 19:00
 ASEC Technician Name : Balu Mylabathula


PLACEMENT INFORMATION - Cylinder

Set Number: B	Laboratory Number: 2026-075
Date Sampled: 03/27/2026	Time Sampled: 14:00
Sampled By: Balu Mylabathula	Concrete Supplier: ENRST
Contractor: N/A	Mix ID: NON AEA
Truck Number: 7	Quantity of Load: 9
Time Batched: :	Specified Strength: 3000
Location of Placement: 5	Concrete Temp (°f): 75
Number of Samples Cast: 5	Air Content (%): 3.2
Ambient Temp (°f): N/A	Unit Weight (pcf): 149.2
Slump (in.): 6	Water Added (gal.): N/A

Specimen Number	Scheduled Test Date	Date Tested	Age (Days)	Dia (in.)	Area (sq in.)	Max Load (lbf)	Strength (psi)	% Design Strength	Fracture Type
1	04/03/2026	04/03/2026	7	3.98	12.44	34249	2750	91.7	Type 2
2	04/24/2026	04/24/2026	28	3.97	12.38	31844	2570	85.7	Type 4
3	04/24/2026	04/24/2026	28	3.97	12.38	34200	2760	92.0	Type 2
4	04/24/2026	04/24/2026	28	3.97	12.38	31232	2520	84.0	Type 2
5	05/22/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

UNLESS OTHERWISE SPECIFIED, TESTS WERE PERFORMED IN ACCORDANCE WITH ASTM METHODS C31, C39, C138, C143, C173, C1064.

(1) Cone (2) Cone-split (3) Vertical (4) Shear (5) Edge Fracture (6) Pointed

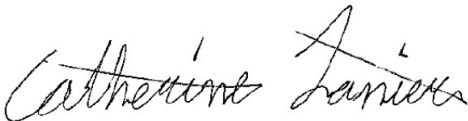

Catherine Lanier
 Lab Manager



Kenneth Mosman

Date : 03/27/2026
 Project No : 2025C214
 Client Company : Artisan
 Arrival Time : 03/27/2026 11:00
 Onsite Hours : 08:00

ASEC Report ID : 91929
 Name of the Project : NW Unit 4 BRIDGE (Materials Testing)
 Project Location : Dallas
 Weather : sunny
 Departure Time : 03/27/2026 19:00
 ASEC Technician Name : Balu Mylabathula


PLACEMENT INFORMATION - Cylinder

Set Number: C	Laboratory Number: 2026-075
Date Sampled: 03/27/2026	Time Sampled: 18:41
Sampled By: Balu Mylabathula	Concrete Supplier: ERNST
Contractor: N/A	Mix ID: NON AEA
Truck Number: 14	Quantity of Load: 9
Time Batched: N/A	Specified Strength: 3000
Location of Placement: 8	Concrete Temp (°f): 75
Number of Samples Cast: 5	Air Content (%): 2.2
Ambient Temp (°f): N/A	Unit Weight (pcf): 148.6
Slump (in.): 5	Water Added (gal.): N/A

Specimen Number	Scheduled Test Date	Date Tested	Age (Days)	Dia (in.)	Area (sq in.)	Max Load (lbf)	Strength (psi)	% Design Strength	Fracture Type
1	04/03/2026	04/03/2026	7	3.98	12.41	48758	3930	131.0	Type 3
2	04/24/2026	04/24/2026	28	3.97	12.38	52282	4220	140.7	Type 2
3	04/24/2026	04/24/2026	28	3.97	12.38	34691	2800	93.3	Type 2
4	04/24/2026	04/24/2026	28	3.97	12.38	49215	3980	132.7	Type 2
5	05/22/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

UNLESS OTHERWISE SPECIFIED, TESTS WERE PERFORMED IN ACCORDANCE WITH ASTM METHODS C31, C39, C138, C143, C173, C1064.

(1) Cone (2) Cone-split (3) Vertical (4) Shear (5) Edge Fracture (6) Pointed

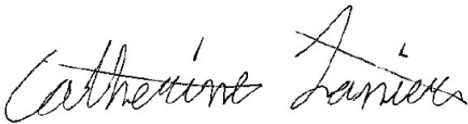

Catherine Lanier
 Lab Manager



Kenneth Mosman