

Date : 04/07/2026
Project No : 2025C214
Client Company : Artisan
Arrival Time :
Onsite Hours : N/A

ASEC Report ID : 94175
Name of the Project : NW Unit 4 BRIDGE (Materials Testing)
Project Location : Dallas
Weather : N/A
Departure Time :
ASEC Technician Name : Narayana Ganesh Undavalli

Location(S): , , , , ,

Testing: 6 Set of concrete specimens (5 per set) were cast during the cast-in-place concrete pour at the above referenced location, in accordance with ASTM C31. The specimen will remain on site for the initial 24-48 hrs curing.

Compliance: Field placement of concrete appeared to be in general accordance with the project specifications (i.e., slump, temperature, etc) (refer to remarks below)
 Deviations and/or noncompliances were noted during the field placement (refer to remarks below)

Specimen Pick Up: 6 Sets of concrete specimens/ 5 specimen per set were picked up & transported to AS Engineering and Consulting LLC (ASEC) for curing and testing in accordance with ASTM C39, C670/1231

Field Curing: Specimen were stored for the initial 24 hours
 Near the poured structure
 In an insulated curing box
 Other

Remarks:

The results presented in this report relate only to the items tested. This report shall not be reproduced, except in full, without written approval from AS Engineering and Consulting LLC.

Date : 04/07/2026
 Project No : 2025C214
 Client Company : Artisan
 Arrival Time :
 Onsite Hours : N/A

ASEC Report ID : 94175
 Name of the Project : NW Unit 4 BRIDGE (Materials Testing)
 Project Location : Dallas
 Weather : N/A
 Departure Time :
 ASEC Technician Name : Narayana Ganesh Undavalli


PLACEMENT INFORMATION - Cylinder

Set Number: A	Laboratory Number: 2026-092
Date Sampled: 04/07/2026	Time Sampled: N/A
Sampled By: Narayana Ganesh Undavalli	Concrete Supplier: N/A
Contractor: N/A	Mix ID: N/A
Truck Number: N/A	Quantity of Load: N/A
Time Batched: N/A	Specified Strength: N/A
Location of Placement: N/A	Concrete Temp (°f): N/A
Number of Samples Cast: 5	Air Content (%): N/A
Ambient Temp (°f): N/A	Unit Weight (pcf): N/A
Slump (in.): N/A	Water Added (gal.): N/A

Specimen Number	Scheduled Test Date	Date Tested	Age (Days)	Dia (in.)	Area (sq in.)	Max Load (lbf)	Strength (psi)	% Design Strength	Fracture Type
1A	04/14/2026	04/14/2026	7	3.98	12.41	36911	2970	N/A	Type 6
2A	05/05/2026	05/05/2026	28	3.98	12.41	58281	4700	N/A	Type 5
3A	05/05/2026	05/05/2026	28	3.98	12.41	56544	4560	N/A	Type 2
4A	05/05/2026	05/05/2026	28	3.98	12.41	63009	5080	N/A	Type 5
5A	06/02/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

UNLESS OTHERWISE SPECIFIED, TESTS WERE PERFORMED IN ACCORDANCE WITH ASTM METHODS C31, C39, C138, C143, C173, C1064.

(1) Cone (2) Cone-split (3) Vertical (4) Shear (5) Edge Fracture (6) Pointed

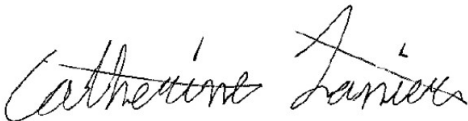

Catherine Lanier
 Lab Manager



Kenneth Mosman

Date : 04/07/2026
 Project No : 2025C214
 Client Company : Artisan
 Arrival Time :
 Onsite Hours : N/A

ASEC Report ID : 94175
 Name of the Project : NW Unit 4 BRIDGE (Materials Testing)
 Project Location : Dallas
 Weather : N/A
 Departure Time :
 ASEC Technician Name : Narayana Ganesh Undavalli


PLACEMENT INFORMATION - Cylinder

Set Number: B	Laboratory Number: 2026-092
Date Sampled: 04/07/2026	Time Sampled: N/A
Sampled By: Narayana Ganesh Undavalli	Concrete Supplier: N/A
Contractor: N/A	Mix ID: N/A
Truck Number: N/A	Quantity of Load: N/A
Time Batched: N/A	Specified Strength: N/A
Location of Placement: N/A	Concrete Temp (°f): N/A
Number of Samples Cast: 5	Air Content (%): N/A
Ambient Temp (°f): N/A	Unit Weight (pcf): N/A
Slump (in.): N/A	Water Added (gal.): N/A

Specimen Number	Scheduled Test Date	Date Tested	Age (Days)	Dia (in.)	Area (sq in.)	Max Load (lbf)	Strength (psi)	% Design Strength	Fracture Type
1B	04/14/2026	04/14/2026	7	3.98	12.41	36784	2960	N/A	Type 5
2B	05/05/2026	05/05/2026	28	3.98	12.41	50222	4050	N/A	Type 5
3B	05/05/2026	05/05/2026	28	3.98	12.41	51061	4110	N/A	Type 2
4B	05/05/2026	05/05/2026	28	3.98	12.41	47913	3860	N/A	Type 3
5B	06/02/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

UNLESS OTHERWISE SPECIFIED, TESTS WERE PERFORMED IN ACCORDANCE WITH ASTM METHODS C31, C39, C138, C143, C173, C1064.

(1) Cone (2) Cone-split (3) Vertical (4) Shear (5) Edge Fracture (6) Pointed

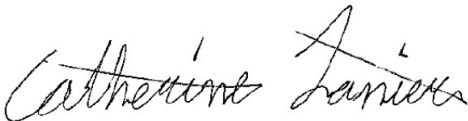

Catherine Lanier
 Lab Manager



Kenneth Mosman

Date : 04/07/2026
 Project No : 2025C214
 Client Company : Artisan
 Arrival Time :
 Onsite Hours : N/A

ASEC Report ID : 94175
 Name of the Project : NW Unit 4 BRIDGE (Materials Testing)
 Project Location : Dallas
 Weather : N/A
 Departure Time :
 ASEC Technician Name : Narayana Ganesh Undavalli


PLACEMENT INFORMATION - Cylinder

Set Number: C	Laboratory Number: 2026-092
Date Sampled: 04/07/2026	Time Sampled: N/A
Sampled By: Narayana Ganesh Undavalli	Concrete Supplier: N/A
Contractor: N/A	Mix ID: N/A
Truck Number: N/A	Quantity of Load: N/A
Time Batched: N/A	Specified Strength: N/A
Location of Placement: N/A	Concrete Temp (°f): N/A
Number of Samples Cast: 5	Air Content (%): N/A
Ambient Temp (°f): N/A	Unit Weight (pcf): N/A
Slump (in.): N/A	Water Added (gal.): N/A

Specimen Number	Scheduled Test Date	Date Tested	Age (Days)	Dia (in.)	Area (sq in.)	Max Load (lbf)	Strength (psi)	% Design Strength	Fracture Type
1C	04/14/2026	04/14/2026	7	3.98	12.44	37543	3020	N/A	Type 2
2C	05/05/2026	05/05/2026	28	3.98	12.44	56125	4510	N/A	Type 5
3C	05/05/2026	05/05/2026	28	3.98	12.44	49544	3980	N/A	Type 2
4C	05/05/2026	05/05/2026	28	3.98	12.44	52821	4250	N/A	Type 5
5C	06/02/2026	06/02/2026	56	N/A	N/A	N/A	NaN	NaN	N/A

UNLESS OTHERWISE SPECIFIED, TESTS WERE PERFORMED IN ACCORDANCE WITH ASTM METHODS C31, C39, C138, C143, C173, C1064.

(1) Cone (2) Cone-split (3) Vertical (4) Shear (5) Edge Fracture (6) Pointed

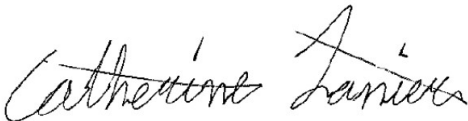

Catherine Lanier
 Lab Manager



Kenneth Mosman

Date : 04/07/2026
 Project No : 2025C214
 Client Company : Artisan
 Arrival Time :
 Onsite Hours : N/A

ASEC Report ID : 94175
 Name of the Project : NW Unit 4 BRIDGE (Materials Testing)
 Project Location : Dallas
 Weather : N/A
 Departure Time :
 ASEC Technician Name : Narayana Ganesh Undavalli


PLACEMENT INFORMATION - Cylinder

Set Number: D	Laboratory Number: 2026-092
Date Sampled: 04/07/2026	Time Sampled: N/A
Sampled By: Narayana Ganesh Undavalli	Concrete Supplier: N/A
Contractor: N/A	Mix ID: N/A
Truck Number: N/A	Quantity of Load: N/A
Time Batched: N/A	Specified Strength: N/A
Location of Placement: N/A	Concrete Temp (°f): N/A
Number of Samples Cast: 5	Air Content (%): N/A
Ambient Temp (°f): N/A	Unit Weight (pcf): N/A
Slump (in.): N/A	Water Added (gal.): N/A

Specimen Number	Scheduled Test Date	Date Tested	Age (Days)	Dia (in.)	Area (sq in.)	Max Load (lbf)	Strength (psi)	% Design Strength	Fracture Type
1D	04/07/2026	04/07/2026	0	3.99	12.47	40729	3270	N/A	Type 6
2D	05/05/2026	05/05/2026	28	3.99	12.47	57624	4620	N/A	Type 5
3D	05/05/2026	05/05/2026	28	3.99	12.47	52251	4190	N/A	Type 3
4D	05/05/2026	05/05/2026	28	3.99	12.47	55343	4440	N/A	Type 5
5D	06/02/2026	06/02/2026	56	3.99	12.47	N/A	N/A	N/A	N/A

UNLESS OTHERWISE SPECIFIED, TESTS WERE PERFORMED IN ACCORDANCE WITH ASTM METHODS C31, C39, C138, C143, C173, C1064.

(1) Cone (2) Cone-split (3) Vertical (4) Shear (5) Edge Fracture (6) Pointed

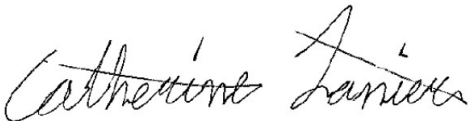

Catherine Lanier
 Lab Manager



Kenneth Mosman

Date : 04/07/2026
 Project No : 2025C214
 Client Company : Artisan
 Arrival Time :
 Onsite Hours : N/A

ASEC Report ID : 94175
 Name of the Project : NW Unit 4 BRIDGE (Materials Testing)
 Project Location : Dallas
 Weather : N/A
 Departure Time :
 ASEC Technician Name : Narayana Ganesh Undavalli


PLACEMENT INFORMATION - Cylinder

Set Number: E	Laboratory Number: 2026-092
Date Sampled: 04/07/2026	Time Sampled: N/A
Sampled By: Narayana Ganesh Undavalli	Concrete Supplier: N/A
Contractor: N/A	Mix ID: N/A
Truck Number: N/A	Quantity of Load: N/A
Time Batched: N/A	Specified Strength: N/A
Location of Placement: N/A	Concrete Temp (°f): N/A
Number of Samples Cast: 5	Air Content (%): N/A
Ambient Temp (°f): N/A	Unit Weight (pcf): N/A
Slump (in.): N/A	Water Added (gal.): N/A

Specimen Number	Scheduled Test Date	Date Tested	Age (Days)	Dia (in.)	Area (sq in.)	Max Load (lbf)	Strength (psi)	% Design Strength	Fracture Type
1E	04/14/2026	04/14/2026	7	3.99	12.48	33222	2660	N/A	Type 5
2E	05/05/2026	05/05/2026	28	3.99	12.50	43877	3510	N/A	Type 5
3E	05/05/2026	05/05/2026	28	3.99	12.50	44382	3550	N/A	Type 6
4E	05/05/2026	05/05/2026	28	3.99	12.50	46030	3680	N/A	Type 5
5E	06/02/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

UNLESS OTHERWISE SPECIFIED, TESTS WERE PERFORMED IN ACCORDANCE WITH ASTM METHODS C31, C39, C138, C143, C173, C1064.

(1) Cone (2) Cone-split (3) Vertical (4) Shear (5) Edge Fracture (6) Pointed

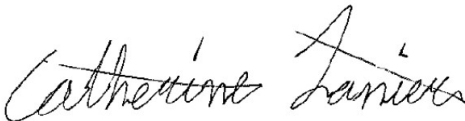

Catherine Lanier
 Lab Manager



Kenneth Mosman

Date : 04/07/2026
 Project No : 2025C214
 Client Company : Artisan
 Arrival Time :
 Onsite Hours : N/A

ASEC Report ID : 94175
 Name of the Project : NW Unit 4 BRIDGE (Materials Testing)
 Project Location : Dallas
 Weather : N/A
 Departure Time :
 ASEC Technician Name : Narayana Ganesh Undavalli


PLACEMENT INFORMATION - Cylinder

Set Number: F	Laboratory Number: 2026-092
Date Sampled: 04/07/2026	Time Sampled: N/A
Sampled By: Narayana Ganesh Undavalli	Concrete Supplier: N/A
Contractor: N/A	Mix ID: N/A
Truck Number: N/A	Quantity of Load: N/A
Time Batched: N/A	Specified Strength: N/A
Location of Placement: N/A	Concrete Temp (°f): N/A
Number of Samples Cast: 5	Air Content (%): N/A
Ambient Temp (°f): N/A	Unit Weight (pcf): N/A
Slump (in.): N/A	Water Added (gal.): N/A

Specimen Number	Scheduled Test Date	Date Tested	Age (Days)	Dia (in.)	Area (sq in.)	Max Load (lbf)	Strength (psi)	% Design Strength	Fracture Type
1F	04/14/2026	04/14/2026	7	3.98	12.44	32695	2630	N/A	Type 5
2F	05/05/2026	05/05/2026	28	3.98	12.44	48018	3860	N/A	Type 3
3f	05/05/2026	05/05/2026	28	3.98	12.44	48143	3870	N/A	Type 5
4F	05/05/2026	05/05/2026	28	3.98	12.44	46701	3750	N/A	Type 5
5F	06/02/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

UNLESS OTHERWISE SPECIFIED, TESTS WERE PERFORMED IN ACCORDANCE WITH ASTM METHODS C31, C39, C138, C143, C173, C1064.

(1) Cone (2) Cone-split (3) Vertical (4) Shear (5) Edge Fracture (6) Pointed

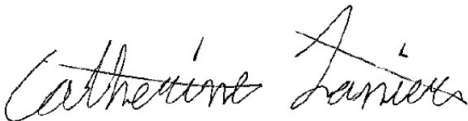

Catherine Lanier
 Lab Manager



Kenneth Mosman