

Date : 01/29/2026
Project No : 2025C280
Client Company : WSP
Arrival Time : 01/29/2026 10:00
Onsite Hours : 03:00

ASEC Report ID : 89941
Name of the Project : Lee Road
Project Location : Douglasville
Weather : Overcast
Departure Time : 01/29/2026 13:00
ASEC Technician Name : Mahendra Mylabathula

Location(S): Sidewalk on Lee Road

Testing: 1 Set of concrete specimens (5 per set) were cast during the cast-in-place concrete pour at the above referenced location, in accordance with ASTM C31. The specimen will remain on site for the initial 24-48 hrs curing.

Compliance: Field placement of concrete appeared to be in general accordance with the project specifications (i.e., slump, temperature, etc) (refer to remarks below)
 Deviations and/or noncompliances were noted during the field placement (refer to remarks below)

Specimen Pick Up: 1 Sets of concrete specimens/ 5 specimen per set were picked up & transported to AS Engineering and Consulting LLC (ASEC) for curing and testing in accordance with ASTM C39, C670/1231

Field Curing: Specimen were stored for the initial 24 hours
 Near the poured structure
 In an insulated curing box
 Other

Remarks:

The results presented in this report relate only to the items tested. This report shall not be reproduced, except in full, without written approval from AS Engineering and Consulting LLC.

Date : 01/29/2026
 Project No : 2025C280
 Client Company : WSP
 Arrival Time : 01/29/2026 10:00
 Onsite Hours : 03:00

ASEC Report ID : 89941
 Name of the Project : Lee Road
 Project Location : Douglasville
 Weather : Overcast
 Departure Time : 01/29/2026 13:00
 ASEC Technician Name : Mahendra Mylabathula


PLACEMENT INFORMATION - Cylinder

Set Number: 2026-016	Laboratory Number: 2026-016
Date Sampled: 01/29/2026	Time Sampled: 12:20
Sampled By: Mahendra Mylabathula	Concrete Supplier: Thomas
Contractor: Curb and Gutter Contracting Co.	Mix ID: 139651
Truck Number: 2489	Quantity of Load: 9
Time Batched: 11:22	Specified Strength: N/A
Location of Placement: Sidewalk on Lee Road	Concrete Temp (°f): 50
Number of Samples Cast: 5	Air Content (%): 5
Ambient Temp (°f): 40	Unit Weight (pcf): 15.1
Slump (in.): 3.5	Water Added (gal.): N/A

Specimen Number	Scheduled Test Date	Date Tested	Age (Days)	Dia (in.)	Area (sq in.)	Max Load (lbf)	Strength (psi)	% Design Strength	Fracture Type
A	02/05/2026	02/05/2026	7	3.93	12.15	31078	2560	N/A	Type 5
B	02/26/2026	02/26/2026	28	3.90	11.95	44730	3740	N/A	Type 2
C	02/26/2026	02/26/2026	28	3.90	11.95	47670	3990	N/A	Type 2
D	02/26/2026	02/26/2026	28	3.90	11.95	47634	3990	N/A	Type 2
E	03/26/2026	03/26/2026	55	3.90	11.95	56913	4760	N/A	Type 2

UNLESS OTHERWISE SPECIFIED, TESTS WERE PERFORMED IN ACCORDANCE WITH ASTM METHODS C31, C39, C138, C143, C173, C1064.

(1) Cone (2) Cone-split (3) Vertical (4) Shear (5) Edge Fracture (6) Pointed

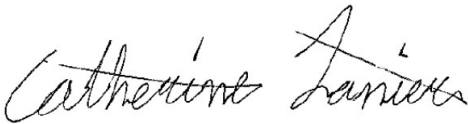

Catherine Lanier
 Lab Manager



Kenneth Mosman