

Date : 03/05/2026
Project No : 2025C280
Client Company : WSP
Arrival Time : 02/10/2026
Onsite Hours : N/A

ASEC Report ID : 90956
Name of the Project : Lee Road
Project Location : Douglasville
Weather : N/A
Departure Time : 02/10/2026
ASEC Technician Name : Balu Mylabathula

Location(S): Sidewalk

Testing: 1 Set of concrete specimens (5 per set) were cast during the cast-in-place concrete pour at the above referenced location, in accordance with ASTM C31. The specimen will remain on site for the initial 24-48 hrs curing.

Compliance: Field placement of concrete appeared to be in general accordance with the project specifications (i.e., slump, temperature, etc) (refer to remarks below)
 Deviations and/or noncompliances were noted during the field placement (refer to remarks below)

Specimen Pick Up: 1 Sets of concrete specimens/ 5 specimen per set were picked up & transported to AS Engineering and Consulting LLC (ASEC) for curing and testing in accordance with ASTM C39, C670/1231

Field Curing: Specimen were stored for the initial 24 hours
 Near the poured structure
 In an insulated curing box
 Other

Remarks:

The results presented in this report relate only to the items tested. This report shall not be reproduced, except in full, without written approval from AS Engineering and Consulting LLC.

Date : 03/05/2026
 Project No : 2025C280
 Client Company : WSP
 Arrival Time : 02/10/2026
 Onsite Hours : N/A

ASEC Report ID : 90956
 Name of the Project : Lee Road
 Project Location : Douglasville
 Weather : N/A
 Departure Time : 02/10/2026
 ASEC Technician Name : Balu Mylabathula


PLACEMENT INFORMATION - Cylinder

| | |
|--|------------------------------------|
| Set Number: A | Laboratory Number: 2026-022 |
| Date Sampled: 02/09/2026 | Time Sampled: N/A |
| Sampled By: Balu Mylabathula | Concrete Supplier: Thomas |
| Contractor: C&G Concrete Construction | Mix ID: N/A |
| Truck Number: N/A | Quantity of Load: 9 |
| Time Batched: N/A | Specified Strength: 3000 |
| Location of Placement: Sidewalk | Concrete Temp (°f): 60 |
| Number of Samples Cast: 5 | Air Content (%): 5.5 |
| Ambient Temp (°f): 54 | Unit Weight (pcf): 138.6 |
| Slump (in.): 6 | Water Added (gal.): N/A |

| Specimen Number | Scheduled Test Date | Date Tested | Age (Days) | Dia (in.) | Area (sq in.) | Max Load (lbf) | Strength (psi) | % Design Strength | Fracture Type |
|-----------------|---------------------|-------------|------------|-----------|---------------|----------------|----------------|-------------------|---------------|
| A | 02/16/2026 | 02/16/2026 | 7 | 3.90 | 11.95 | 18065 | 1510 | 50.3 | Type 2 |
| B | 03/11/2026 | 03/11/2026 | 28 | 4.00 | 12.57 | 29550 | 2350 | 78.3 | Type 2 |
| C | 03/11/2026 | 03/11/2026 | 28 | 4.00 | 12.57 | 28038 | 2230 | 74.3 | Type 2 |
| D | 03/11/2026 | 03/11/2026 | 29 | 4.00 | 12.57 | 29036 | 2310 | 77.0 | Type 2 |
| E | 04/08/2026 | 04/08/2026 | 57 | 3.75 | 11.04 | 35082 | 3180 | 106.0 | Type 2 |

UNLESS OTHERWISE SPECIFIED, TESTS WERE PERFORMED IN ACCORDANCE WITH ASTM METHODS C31, C39, C138, C143, C173, C1064.

(1) Cone (2) Cone-split (3) Vertical (4) Shear (5) Edge Fracture (6) Pointed

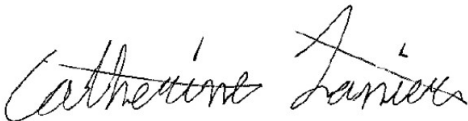

Catherine Lanier
 Lab Manager



Kenneth Mosman