

Date : 03/23/2026  
Project No : 2026C115-WO 1  
Client Company : WSP  
Arrival Time :  
Onsite Hours : N/A

ASEC Report ID : 91975  
Name of the Project : Lanier Islands Parkway  
Project Location : Buford  
Weather : N/A  
Departure Time :  
ASEC Technician Name : Mahendra Mylabathula

---

**Location(S):** F2, F8, F16, F20

**Testing:** 1 Set of concrete specimens (5 per set) were cast during the cast-in-place concrete pour at the above referenced location, in accordance with ASTM C31. The specimen will remain on site for the initial 24-48 hrs curing.

**Compliance:**  Field placement of concrete appeared to be in general accordance with the project specifications (i.e., slump, temperature, etc) (refer to remarks below)  
 Deviations and/or noncompliances were noted during the field placement (refer to remarks below)

**Specimen Pick Up:** 1 Sets of concrete specimens/ 5 specimen per set were picked up & transported to AS Engineering and Consulting LLC (ASEC) for curing and testing in accordance with ASTM C39, C670/1231

**Field Curing:** Specimen were stored for the initial 24 hours  
 Near the poured structure  
 In an insulated curing box  
 Other

**Remarks:**

The results presented in this report relate only to the items tested. This report shall not be reproduced, except in full, without written approval from AS Engineering and Consulting LLC.

Date : 03/23/2026  
 Project No : 2026C115-WO 1  
 Client Company : WSP  
 Arrival Time :  
 Onsite Hours : N/A

ASEC Report ID : 91975  
 Name of the Project : Lanier Islands Parkway  
 Project Location : Buford  
 Weather : N/A  
 Departure Time :  
 ASEC Technician Name : Mahendra Mylabathula


**PLACEMENT INFORMATION - Cylinder**

<b>Set Number:</b> A	<b>Laboratory Number:</b> 2026-067
<b>Date Sampled:</b> 03/23/2026	<b>Time Sampled:</b> 04:00
<b>Sampled By:</b> Mahendra Mylabathula	<b>Concrete Supplier:</b> MORGAN
<b>Contractor:</b> CONLAN COMPANY	<b>Mix ID:</b> 4000 57-89 SOG NA
<b>Truck Number:</b> 1	<b>Quantity of Load:</b> 10
<b>Time Batched:</b> N/A	<b>Specified Strength:</b> 4000
<b>Location of Placement:</b> F2	<b>Concrete Temp (°f):</b> 70
<b>Number of Samples Cast:</b> 5	<b>Air Content (%):</b> 3
<b>Ambient Temp (°f):</b> N/A	<b>Unit Weight (pcf):</b> 148.8
<b>Slump (in.):</b> 6	<b>Water Added (gal.):</b> N/A

Specimen Number	Scheduled Test Date	Date Tested	Age (Days)	Dia (in.)	Area (sq in.)	Max Load (lbf)	Strength (psi)	% Design Strength	Fracture Type
1	03/30/2026	03/30/2026	7	4.00	12.57	51338	4080	102.0	Type 2
2	04/20/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
3	04/20/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
4	04/20/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
5	05/18/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

UNLESS OTHERWISE SPECIFIED, TESTS WERE PERFORMED IN ACCORDANCE WITH ASTM METHODS C31, C39, C138, C143, C173, C1064.

**(1) Cone (2) Cone-split (3) Vertical (4) Shear (5) Edge Fracture (6) Pointed**

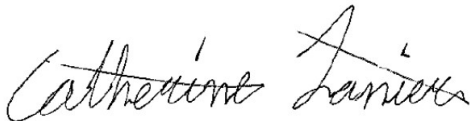

Catherine Lanier  
 Lab Manager



Kenneth Mosman

Date : 03/23/2026  
 Project No : 2026C115-WO 1  
 Client Company : WSP  
 Arrival Time :  
 Onsite Hours : N/A

ASEC Report ID : 91975  
 Name of the Project : Lanier Islands Parkway  
 Project Location : Buford  
 Weather : N/A  
 Departure Time :  
 ASEC Technician Name : Mahendra Mylabathula


**PLACEMENT INFORMATION - Cylinder**

<b>Set Number:</b> B	<b>Laboratory Number:</b> 2026-067
<b>Date Sampled:</b> 03/23/2026	<b>Time Sampled:</b> 5
<b>Sampled By:</b> Mahendra Mylabathula	<b>Concrete Supplier:</b> MORGAN
<b>Contractor:</b> COLMAN	<b>Mix ID:</b> 4000 57-89 SOG NA
<b>Truck Number:</b> 11	<b>Quantity of Load:</b> 10
<b>Time Batched:</b> N/A	<b>Specified Strength:</b> 4000
<b>Location of Placement:</b> F8	<b>Concrete Temp (°f):</b> 75
<b>Number of Samples Cast:</b> 5	<b>Air Content (%):</b> 2.5
<b>Ambient Temp (°f):</b> N/A	<b>Unit Weight (pcf):</b> 147.5
<b>Slump (in.):</b> 6	<b>Water Added (gal.):</b> N/A

Specimen Number	Scheduled Test Date	Date Tested	Age (Days)	Dia (in.)	Area (sq in.)	Max Load (lbf)	Strength (psi)	% Design Strength	Fracture Type
No test results available									

UNLESS OTHERWISE SPECIFIED, TESTS WERE PERFORMED IN ACCORDANCE WITH ASTM METHODS C31, C39, C138, C143, C173, C1064.

**(1) Cone (2) Cone-split (3) Vertical (4) Shear (5) Edge Fracture (6) Pointed**

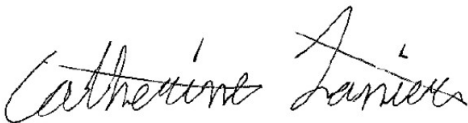

**Catherine Lanier**  
 1  
 Lab Manager



**Kenneth Mosman**

Date : 03/23/2026  
 Project No : 2026C115-WO 1  
 Client Company : WSP  
 Arrival Time :  
 Onsite Hours : N/A

ASEC Report ID : 91975  
 Name of the Project : Lanier Islands Parkway  
 Project Location : Buford  
 Weather : N/A  
 Departure Time :  
 ASEC Technician Name : Mahendra Mylabathula


**PLACEMENT INFORMATION - Cylinder**

<b>Set Number:</b> C	<b>Laboratory Number:</b> 2026-067
<b>Date Sampled:</b> 03/23/2026	<b>Time Sampled:</b> 6
<b>Sampled By:</b> Mahendra Mylabathula	<b>Concrete Supplier:</b> MORGAN
<b>Contractor:</b> COLMAN	<b>Mix ID:</b> 4000 57-89 SOG NA
<b>Truck Number:</b> 21	<b>Quantity of Load:</b> 10
<b>Time Batched:</b> N/A	<b>Specified Strength:</b> 4000
<b>Location of Placement:</b> F16	<b>Concrete Temp (°f):</b> 70
<b>Number of Samples Cast:</b> 5	<b>Air Content (%):</b> 3
<b>Ambient Temp (°f):</b> N/A	<b>Unit Weight (pcf):</b> 149.7
<b>Slump (in.):</b> 5	<b>Water Added (gal.):</b> N/A

Specimen Number	Scheduled Test Date	Date Tested	Age (Days)	Dia (in.)	Area (sq in.)	Max Load (lbf)	Strength (psi)	% Design Strength	Fracture Type
No test results available									

UNLESS OTHERWISE SPECIFIED, TESTS WERE PERFORMED IN ACCORDANCE WITH ASTM METHODS C31, C39, C138, C143, C173, C1064.

**(1) Cone (2) Cone-split (3) Vertical (4) Shear (5) Edge Fracture (6) Pointed**

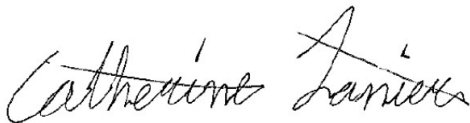

**Catherine Lanier**  
 1  
 Lab Manager



**Kenneth Mosman**

Date : 03/23/2026  
 Project No : 2026C115-WO 1  
 Client Company : WSP  
 Arrival Time :  
 Onsite Hours : N/A

ASEC Report ID : 91975  
 Name of the Project : Lanier Islands Parkway  
 Project Location : Buford  
 Weather : N/A  
 Departure Time :  
 ASEC Technician Name : Mahendra Mylabathula


**PLACEMENT INFORMATION - Cylinder**

<b>Set Number:</b> D	<b>Laboratory Number:</b> 2026-067
<b>Date Sampled:</b> 03/23/2026	<b>Time Sampled:</b> 7
<b>Sampled By:</b> Mahendra Mylabathula	<b>Concrete Supplier:</b> MORGAN
<b>Contractor:</b> COLMAN	<b>Mix ID:</b> 4000 57-89 SOG NA
<b>Truck Number:</b> 31	<b>Quantity of Load:</b> 10
<b>Time Batched:</b> N/A	<b>Specified Strength:</b> 4000
<b>Location of Placement:</b> F20	<b>Concrete Temp (°f):</b> 70
<b>Number of Samples Cast:</b> 5	<b>Air Content (%):</b> 2.5
<b>Ambient Temp (°f):</b> N/A	<b>Unit Weight (pcf):</b> 147.6
<b>Slump (in.):</b> 5	<b>Water Added (gal.):</b> N/A

Specimen Number	Scheduled Test Date	Date Tested	Age (Days)	Dia (in.)	Area (sq in.)	Max Load (lbf)	Strength (psi)	% Design Strength	Fracture Type
No test results available									

UNLESS OTHERWISE SPECIFIED, TESTS WERE PERFORMED IN ACCORDANCE WITH ASTM METHODS C31, C39, C138, C143, C173, C1064.

**(1) Cone (2) Cone-split (3) Vertical (4) Shear (5) Edge Fracture (6) Pointed**

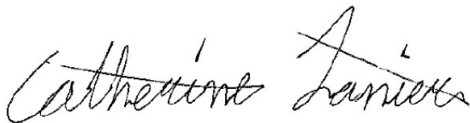

**Catherine Lanier**  
 1  
 Lab Manager



**Kenneth Mosman**