

Date : 03/26/2026
Project No : 2026C115-WO 1
Client Company : WSP
Arrival Time : 03/26/2026 03:20
Onsite Hours : 03:15

ASEC Report ID : 91931
Name of the Project : Lanier Islands Parkway
Project Location : Buford
Weather : N/A
Departure Time : 03/26/2026 06:30
ASEC Technician Name : Zabihullah Lodin

Location(S): 10/210 cu. yd., 110/210 cu. yd., 210/210 cu. yd.

Testing: 3 Set of concrete specimens (5 per set) were cast during the cast-in-place concrete pour at the above referenced location, in accordance with ASTM C31. The specimen will remain on site for the initial 24-48 hrs curing.

Compliance: Field placement of concrete appeared to be in general accordance with the project specifications (i.e., slump, temperature, etc) (refer to remarks below)
 Deviations and/or noncompliances were noted during the field placement (refer to remarks below)

Specimen Pick Up: 3 Sets of concrete specimens/ 5 specimen per set were picked up & transported to AS Engineering and Consulting LLC (ASEC) for curing and testing in accordance with ASTM C39, C670/1231

Field Curing: Specimen were stored for the initial 24 hours
 Near the poured structure
 In an insulated curing box
 Other

Remarks:

The results presented in this report relate only to the items tested. This report shall not be reproduced, except in full, without written approval from AS Engineering and Consulting LLC.

Date : 03/26/2026
 Project No : 2026C115-WO 1
 Client Company : WSP
 Arrival Time : 03/26/2026 03:20
 Onsite Hours : 03:15

ASEC Report ID : 91931
 Name of the Project : Lanier Islands Parkway
 Project Location : Buford
 Weather : N/A
 Departure Time : 03/26/2026 06:30
 ASEC Technician Name : Zabihullah Lodin


PLACEMENT INFORMATION - Cylinder

Set Number: A	Laboratory Number: 2026-073
Date Sampled: 03/26/2026	Time Sampled: 03:25
Sampled By: Zabihullah Lodin	Concrete Supplier: N/A
Contractor: N/A	Mix ID: N/A
Truck Number: N/A	Quantity of Load: N/A
Time Batched: N/A	Specified Strength: N/A
Location of Placement: 10/210 cu. yd.	Concrete Temp (°f): 65
Number of Samples Cast: 5	Air Content (%): 1.5
Ambient Temp (°f): 51	Unit Weight (pcf): 144.8
Slump (in.): 6.5	Water Added (gal.): N/A

Specimen Number	Scheduled Test Date	Date Tested	Age (Days)	Dia (in.)	Area (sq in.)	Max Load (lbf)	Strength (psi)	% Design Strength	Fracture Type
1	04/02/2026	04/02/2026	7	3.98	12.41	55758	4490	N/A	Type 2
2	04/23/2026	04/23/2026	28	3.97	12.38	71772	5800	N/A	Type 6
3	04/23/2026	04/23/2026	28	3.97	12.38	67070	5420	N/A	Type 2
4	04/23/2026	04/23/2026	28	3.97	12.38	66384	5360	N/A	Type 2
5	05/21/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

UNLESS OTHERWISE SPECIFIED, TESTS WERE PERFORMED IN ACCORDANCE WITH ASTM METHODS C31, C39, C138, C143, C173, C1064.

(1) Cone (2) Cone-split (3) Vertical (4) Shear (5) Edge Fracture (6) Pointed

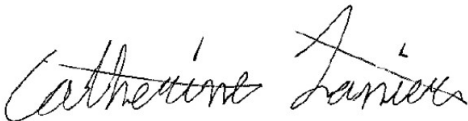

Catherine Lanier
 Lab Manager



Kenneth Mosman

Date : 03/26/2026
 Project No : 2026C115-WO 1
 Client Company : WSP
 Arrival Time : 03/26/2026 03:20
 Onsite Hours : 03:15

ASEC Report ID : 91931
 Name of the Project : Lanier Islands Parkway
 Project Location : Buford
 Weather : N/A
 Departure Time : 03/26/2026 06:30
 ASEC Technician Name : Zabihullah Lodin


PLACEMENT INFORMATION - Cylinder

Set Number: B	Laboratory Number: 2026-073
Date Sampled: 03/26/2026	Time Sampled: 04:15
Sampled By: Zabihullah Lodin	Concrete Supplier: N/A
Contractor: N/A	Mix ID: N/A
Truck Number: N/A	Quantity of Load: N/A
Time Batched: N/A	Specified Strength: N/A
Location of Placement: 110/210 cu. yd.	Concrete Temp (°f): 65
Number of Samples Cast: 5	Air Content (%): 1.5
Ambient Temp (°f): 53	Unit Weight (pcf): 145.6
Slump (in.): 7	Water Added (gal.): N/A

Specimen Number	Scheduled Test Date	Date Tested	Age (Days)	Dia (in.)	Area (sq in.)	Max Load (lbf)	Strength (psi)	% Design Strength	Fracture Type
1	04/02/2026	04/02/2026	7	3.97	12.38	43096	3480	N/A	Type 2
2	04/23/2026	04/23/2026	28	3.97	12.38	66829	5400	N/A	Type 5
3	04/23/2026	04/23/2026	28	3.97	12.38	68060	5500	N/A	Type 2
4	04/23/2026	04/23/2026	28	3.97	12.38	69550	5620	N/A	Type 2
5	05/21/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

UNLESS OTHERWISE SPECIFIED, TESTS WERE PERFORMED IN ACCORDANCE WITH ASTM METHODS C31, C39, C138, C143, C173, C1064.

(1) Cone (2) Cone-split (3) Vertical (4) Shear (5) Edge Fracture (6) Pointed

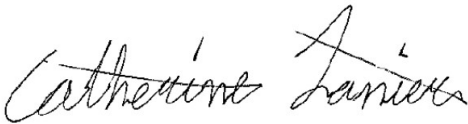

Catherine Lanier
 Lab Manager



Kenneth Mosman

Date : 03/26/2026
 Project No : 2026C115-WO 1
 Client Company : WSP
 Arrival Time : 03/26/2026 03:20
 Onsite Hours : 03:15

ASEC Report ID : 91931
 Name of the Project : Lanier Islands Parkway
 Project Location : Buford
 Weather : N/A
 Departure Time : 03/26/2026 06:30
 ASEC Technician Name : Zabihullah Lodin


PLACEMENT INFORMATION - Cylinder

Set Number: C	Laboratory Number: 2026-073
Date Sampled: 03/26/2026	Time Sampled: N/A
Sampled By: Zabihullah Lodin	Concrete Supplier: N/A
Contractor: N/A	Mix ID: N/A
Truck Number: N/A	Quantity of Load: N/A
Time Batched: N/A	Specified Strength: N/A
Location of Placement: 210/210 cu. yd.	Concrete Temp (°f): 65
Number of Samples Cast: 5	Air Content (%): 1.6
Ambient Temp (°f): 52	Unit Weight (pcf): 145.6
Slump (in.): 6	Water Added (gal.): N/A

Specimen Number	Scheduled Test Date	Date Tested	Age (Days)	Dia (in.)	Area (sq in.)	Max Load (lbf)	Strength (psi)	% Design Strength	Fracture Type
1	04/02/2026	04/02/2026	7	3.98	12.44	53450	4300	N/A	Type 2
2	04/23/2026	04/23/2026	28	3.97	12.38	58514	4730	N/A	Type 2
3	04/23/2026	04/23/2026	28	3.97	12.38	59326	4790	N/A	Type 4
4	04/23/2026	04/23/2026	28	3.97	12.38	58558	4730	N/A	Type 2
5	05/21/2026	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

UNLESS OTHERWISE SPECIFIED, TESTS WERE PERFORMED IN ACCORDANCE WITH ASTM METHODS C31, C39, C138, C143, C173, C1064.

(1) Cone (2) Cone-split (3) Vertical (4) Shear (5) Edge Fracture (6) Pointed

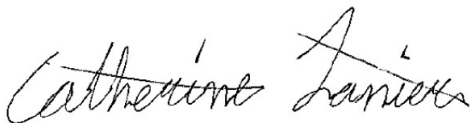

Catherine Lanier
 Lab Manager



Kenneth Mosman