

Date : 06/09/2026
Project No : 2026C122
Client Company : WSP
Arrival Time : 05/11/2026 11:00
Onsite Hours : 01:30

ASEC Report ID : 95099
Name of the Project : Courtesy Pkwy Expansion
Project Location : Conyers
Weather : N/A
Departure Time : 05/11/2026 12:30
ASEC Technician Name : Michael Cius

Location(S): L Line Headwall

Testing: 1 Set of concrete specimens (3 per set) were cast during the cast-in-place concrete pour at the above referenced location, in accordance with ASTM C31. The specimen will remain on site for the initial 24-48 hrs curing.

Compliance: Field placement of concrete appeared to be in general accordance with the project specifications (i.e., slump, temperature, etc) (refer to remarks below)
 Deviations and/or noncompliances were noted during the field placement (refer to remarks below)

Specimen Pick Up: 1 Sets of concrete specimens/ 3 specimen per set were picked up & transported to AS Engineering and Consulting LLC (ASEC) for curing and testing in accordance with ASTM C39, C670/1231

Field Curing: Specimen were stored for the initial 24 hours
 Near the poured structure
 In an insulated curing box
 Other

Remarks:

The results presented in this report relate only to the items tested. This report shall not be reproduced, except in full, without written approval from AS Engineering and Consulting LLC.

Date : 06/09/2026
 Project No : 2026C122
 Client Company : WSP
 Arrival Time : 05/11/2026 11:00
 Onsite Hours : 01:30

ASEC Report ID : 95099
 Name of the Project : Courtesy Pkwy Expansion
 Project Location : Conyers
 Weather : N/A
 Departure Time : 05/11/2026 12:30
 ASEC Technician Name : Michael Cius


PLACEMENT INFORMATION - Cylinder

Set Number: 1	Laboratory Number: 2026-142
Date Sampled: 05/11/2026	Time Sampled: 11:30
Sampled By: Michael Cius	Concrete Supplier: N/A
Contractor: AL Lewis Construction Inc.	Mix ID: 228000
Truck Number: 2137	Quantity of Load: 8
Time Batched: 11:21	Specified Strength: GDOT Class B Specification
Location of Placement: L Line Headwall	Concrete Temp (°f): 80
Number of Samples Cast: 3	Air Content (%): 4
Ambient Temp (°f): N/A	Unit Weight (pcf): N/A
Slump (in.): 4.5	Water Added (gal.): N/A

Specimen Number	Scheduled Test Date	Date Tested	Age (Days)	Dia (in.)	Area (sq in.)	Max Load (lbf)	Strength (psi)	% Design Strength	Fracture Type
1	06/08/2026	06/08/2026	28	3.98	12.44	46906	3770	N/A	Type 5
2	06/08/2026	06/08/2026	28	3.98	12.44	44043	3540	N/A	Type 6
3	06/08/2026	06/08/2026	28	3.98	12.44	47213	3800	N/A	Type 5

UNLESS OTHERWISE SPECIFIED, TESTS WERE PERFORMED IN ACCORDANCE WITH ASTM METHODS C31, C39, C138, C143, C173, C1064.

(1) Cone (2) Cone-split (3) Vertical (4) Shear (5) Edge Fracture (6) Pointed

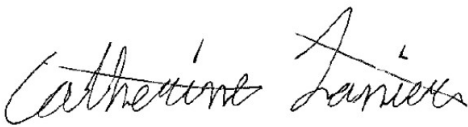

Catherine Lanier
 Lab Manager



Kenneth Mosman