

Date : 06/24/2026
Project No : 2026C122
Client Company : WSP
Arrival Time : 05/22/2026 08:
Onsite Hours : 01:45

ASEC Report ID : 95459
Name of the Project : Courtesy Pkwy Expansion
Project Location : Conyers
Weather : Sunny
Departure Time : 05/22/2026 09:50
ASEC Technician Name : Charles Bolling

Location(S): Parkway Curb, 400 Courtesy Parkway SE.

Testing: 1 Set of concrete specimens (4 per set) were cast during the cast-in-place concrete pour at the above referenced location, in accordance with ASTM C31. The specimen will remain on site for the initial 24-48 hrs curing.

Compliance: Field placement of concrete appeared to be in general accordance with the project specifications (i.e., slump, temperature, etc) (refer to remarks below)
 Deviations and/or noncompliances were noted during the field placement (refer to remarks below)

Specimen Pick Up: 1 Sets of concrete specimens/ 4 specimen per set were picked up & transported to AS Engineering and Consulting LLC (ASEC) for curing and testing in accordance with ASTM C39, C670/1231

Field Curing: Specimen were stored for the initial 24 hours
 Near the poured structure
 In an insulated curing box
 Other

Remarks:

The results presented in this report relate only to the items tested. This report shall not be reproduced, except in full, without written approval from AS Engineering and Consulting LLC.

Date : 06/24/2026
 Project No : 2026C122
 Client Company : WSP
 Arrival Time : 05/22/2026 08:
 Onsite Hours : 01:45

ASEC Report ID : 95459
 Name of the Project : Courtesy Pkwy Expansion
 Project Location : Conyers
 Weather : Sunny
 Departure Time : 05/22/2026 09:50
 ASEC Technician Name : Charles Bolling


PLACEMENT INFORMATION - Cylinder

Set Number: A	Laboratory Number: 2026-168
Date Sampled: 05/22/2026	Time Sampled: 08:51
Sampled By: Charles Bolling	Concrete Supplier: Thomas
Contractor: LAGNIAPPE Development Company	Mix ID: 228000 GDOT Class B Fly
Truck Number: 2170	Quantity of Load: 9
Time Batched: 08:33	Specified Strength: 2200
Location of Placement: Parkway Curb, 400 Courtesy Parkway SE.	Concrete Temp (°f): 71
Number of Samples Cast: 4	Air Content (%): 4.5
Ambient Temp (°f): 74	Unit Weight (pcf): 142.4
Slump (in.): 6.25	Water Added (gal.): N/A

Specimen Number	Scheduled Test Date	Date Tested	Age (Days)	Dia (in.)	Area (sq in.)	Max Load (lbf)	Strength (psi)	% Design Strength	Fracture Type
1	05/29/2026	05/29/2026	7	5.99	28.13	57411	2040	92.7	Type 5
2	06/19/2026	06/19/2026	28	5.99	28.13	104555	3720	169.1	Type 5
3	06/19/2026	06/19/2026	28	5.99	28.13	105106	3740	170.0	Type 5

UNLESS OTHERWISE SPECIFIED, TESTS WERE PERFORMED IN ACCORDANCE WITH ASTM METHODS C31, C39, C138, C143, C173, C1064.

(1) Cone (2) Cone-split (3) Vertical (4) Shear (5) Edge Fracture (6) Pointed

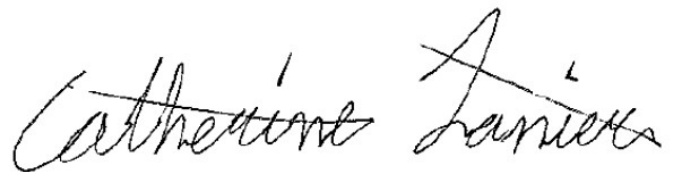

Catherine Lanier
 1
 Lab Manager