

Date : 11/27/2024
Project No : 2024C202
Client Company : CCG
Arrival Time : 11/27/2024 07:30
Onsite Hours : 08:00


ASEC Report ID : 73623
Name of the Project : Old Griffin Rd - Hawthorne Reserve
Project Location : Dallas
Weather : Sunny
Departure Time : 11/27/2024 15:30
ASEC Technician Name : Solomon Cherie

Our AS Engineering & Consulting (ASEC) representative arrived on site to observe field activities. The following tasks were performed:


Observed the placement of fill/grading for Lot #114 today. Compaction tests were performed using a nuclear density gauge. Overall, the results of density testing confirmed that fill compaction met the project and ASTM requirements. Results are attached in separate reports.

In place moisture contents are still much higher than 3 percent over optimum moisture content. These soils need to spread out and aerated prior to fill placement. Contractor has elected to go to placing thinner lifts with compaction testing at 6-inch intervals while these soils remain wet.

Please contact us if you have any questions regarding this report or of the density test results.

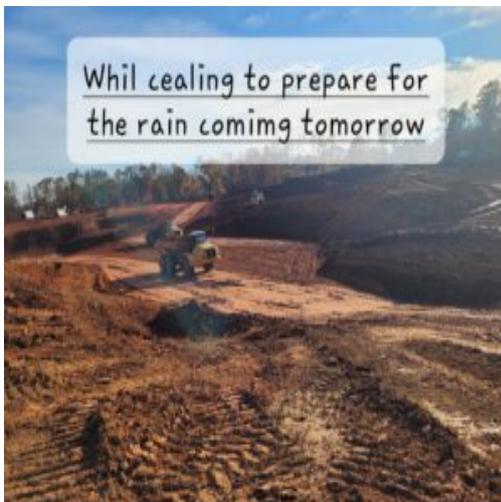

Picture showing the backfill area with 6.0' more fill

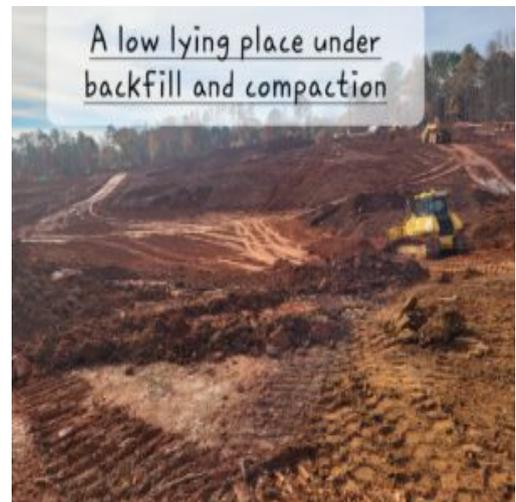

The backfill area with more than 8.0' more fill

Kenneth Mosman

Kenneth Mosman

The results presented in this report relate only to the items tested. This report shall not be reproduced, except in full, without written approval from AS Engineering and Consulting LLC.