

Date : 12/06/2024
Project No : 2024C202
Client Company : CCG
Arrival Time : 12/06/2024 07:15
Onsite Hours : 08:30

ASEC Report ID : 74008
Name of the Project : Old Griffin Rd - Hawthorne Reserve
Project Location : Dallas
Weather : Sunny
Departure Time : 12/06/2024 15:45
ASEC Technician Name : Solomon Cherie

Our AS Engineering & Consulting (ASEC) representative arrived on site to observe field activities. The following tasks were performed:

Observed the placement of fill/grading for Lots #114 and #115 today. Compaction tests were performed using a nuclear density gauge. Overall, the results of density testing confirmed that fill compaction met the project and ASTM requirements. Results are attached in separate reports.

The sewer line between manholes A10, A11 and A12 was excavated today. Compaction was performed using a trench roller and CP 433 CAT. General probing using a 3/8" diameter probe rod found the compacted soils to be stable.

Please contact us if you have any questions regarding this report or of the density test results.




Picture showing an 8.0' deep sewer line



Picture depicting two lots after downcutting

Date : 12/06/2024
Project No : 2024C202
Client Company : CCG
Arrival Time : 12/06/2024 07:15
Onsite Hours : 08:30

ASEC Report ID : 74008
Name of the Project : Old Griffin Rd - Hawthorne Reserve
Project Location : Dallas
Weather : Sunny
Departure Time : 12/06/2024 15:45
ASEC Technician Name : Solomon Cherie

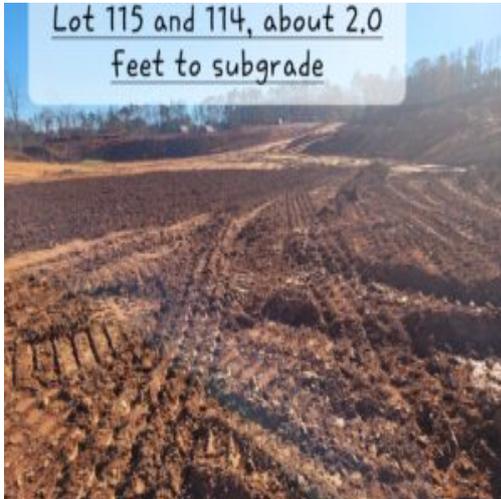

Lots 114 and 115 about 2.0 feet for subgrade

Kenneth Mosman

Kenneth Mosman

The results presented in this report relate only to the items tested. This report shall not be reproduced, except in full, without written approval from AS Engineering and Consulting LLC.